
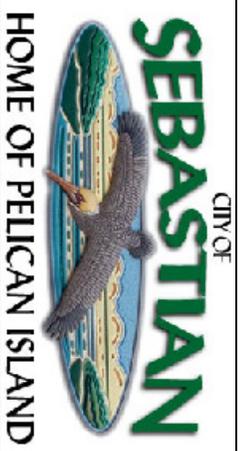


Note: Overhead wiring and service drop conductors shall have a minimum of 22.5ft. of clearance in any direction to water level of pool. Horizontal clearance shall be a minimum of 10ft. measured from inside wall of pool. 680.8

All boxes, covers & fittings are to be UL approved outdoor type. An alternative to GFCI protecting the pump receptacle thru the convenience receptacle is the use of a GFCI-type circuit breaker in the service panel to protect both the convenience & pump receptacles.

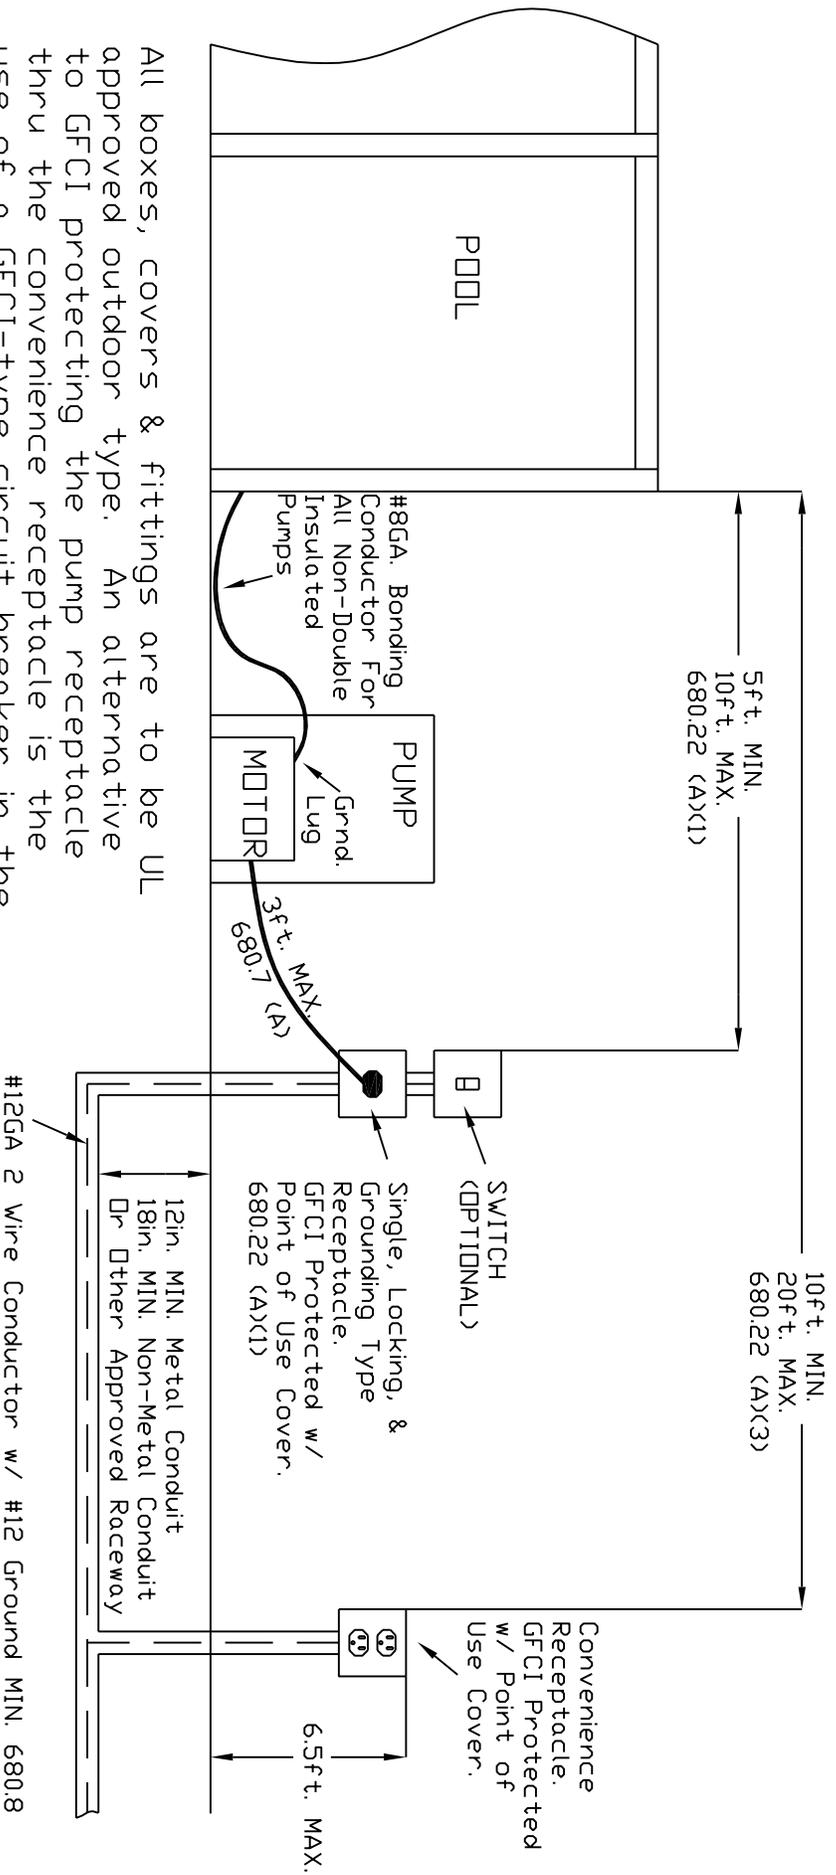

Designed By:	Building Department
Drawn By:	A.J. Engelmeyer
Date:	1 September 2006
Project:	Typical Permanent Pool Layout/NFPA 70 Article 680